
EPRI

THE DIFFERENCE BETWEEN THERMAL RUNAWAY AND IGNITION OF A LITHIUM ION BATTERY



December 2022

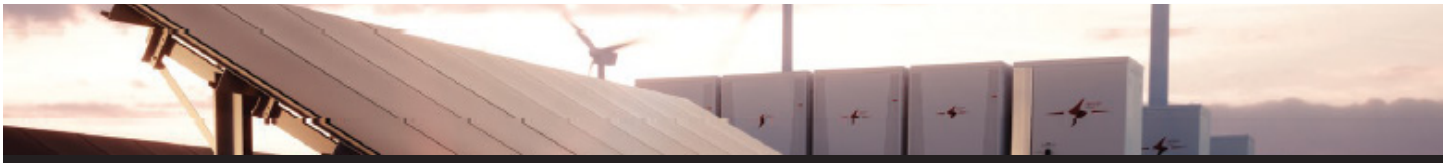

The Difference Between Thermal Runaway and Ignition of a Lithium ion Battery

Thermal runaway is not ignition. In the simplest terms, thermal runaway refers to the irreversible failure of a lithium ion battery that leads to the production of flammable gases. There are many abuse conditions that can trigger thermal runaway, including short circuits, mechanical damage, overcharging or over discharging, and overheating [1, 2, 3]. Thermal runaway could lead to two consequences:

1. Ignition of the unmixed flammable gases can result in a fire.
2. Ignition of the flammable gases mixed with air, often in a confined environment, can lead to an explosion.

A thermal runaway process occurs when the heat generated by exothermic reactions is greater than the heat dissipated to the environment [4]. As depicted in Figure 1, for a lithium ion battery this can start when the solid-electrolyte interphase (SEI) layer breaks down. SEI is a passive, stabilizing layer that forms over the anode surface due to electrochemical incompatibility between the anode and electrolyte. The SEI layer prevents continued electrolyte degradation at the anode surface. As the temperature in the cell increases, this layer breaks down and releases carbon dioxide. The carbon dioxide acts as an ionic and thermal insulator, causing the cell to produce more heat as it tries to complete electrochemical reactions.

When the SEI layer breaks down under abuse conditions, the electrolyte is exposed to the anode surface. That prompts regeneration of the SEI layer and additional decomposition, which moves the thermal runaway process along. Flammable hydrocarbons are produced, and the cell continues to generate heat. Eventually, the heat accumulated in the cell leads to increased temperature, which causes the polymer film separator to melt, allowing for an internal short circuit to occur and more heat production.

As temperatures rise, the cathode starts to break down and release oxygen. The electrolyte solvents react with the oxygen to form carbon dioxide, fluoride gases, and other hydrocarbons. Finally, the polymer binder material used to fabricate the electrodes also breaks down and releases hydrogen fluoride gas [4, 5].

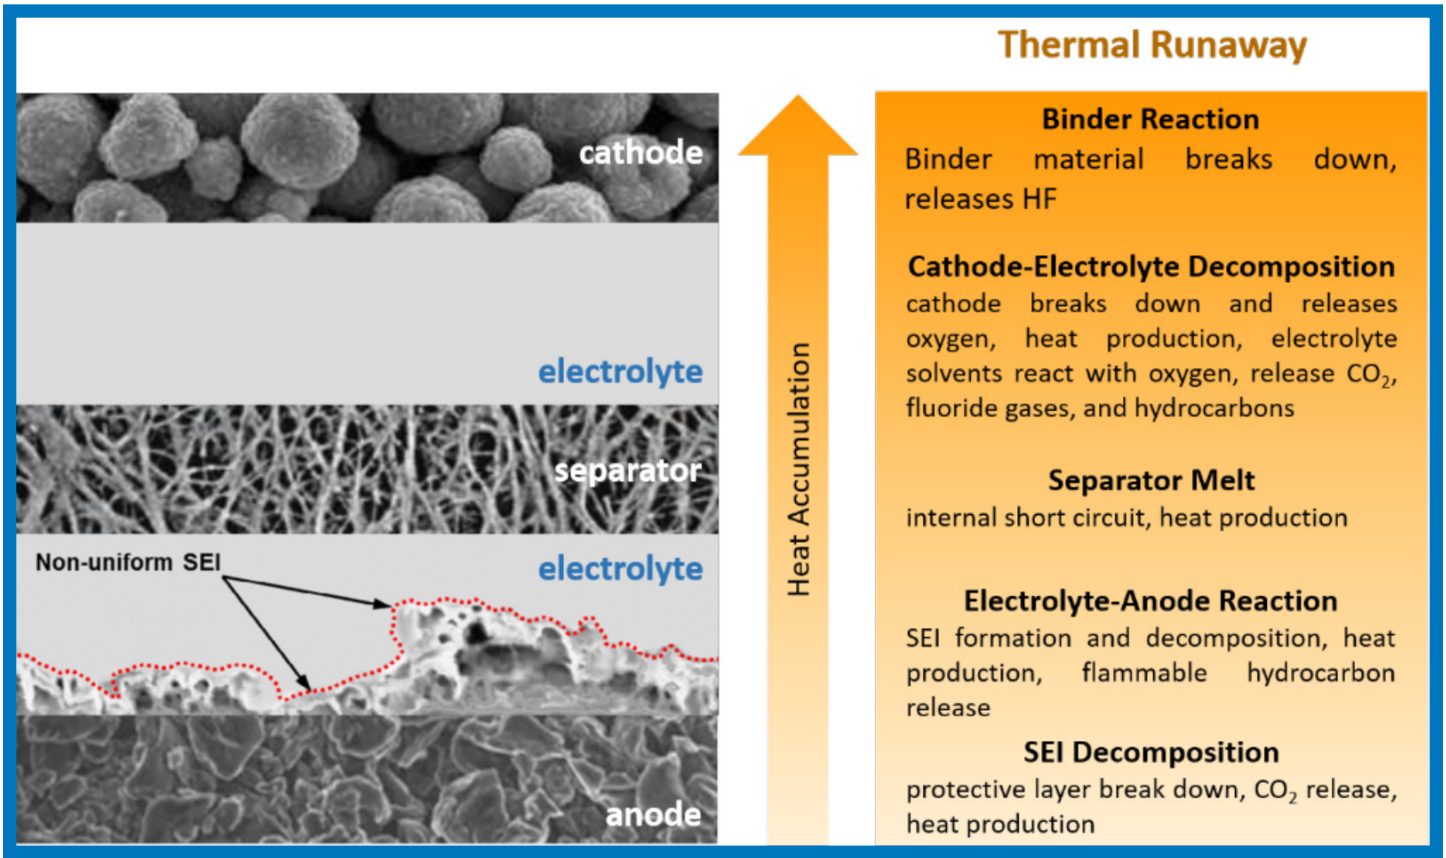
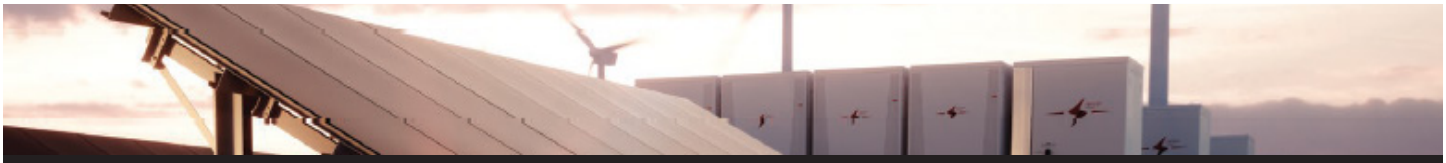


Figure 1 – Depiction of a common thermal runaway process. Image courtesy of EPRI



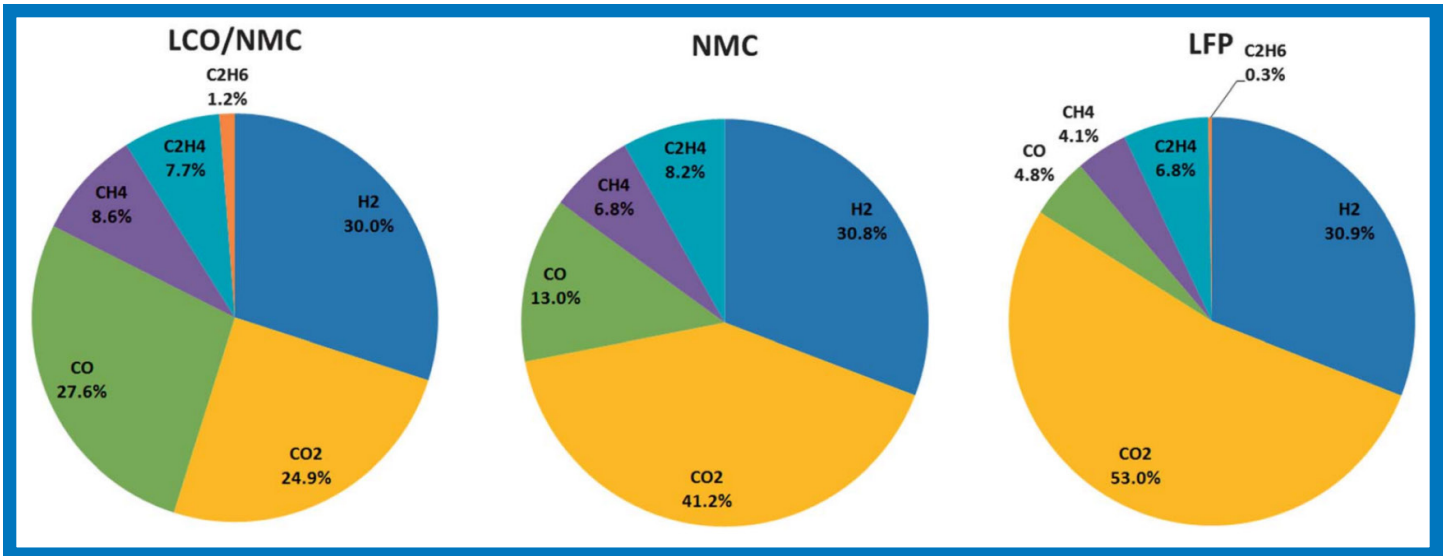


Figure 2 – Detected components of the produced gases (mol%) [6]. Image is licensed under CC BY 3.0.

The thermal runaway process causes cell pressure to increase as the materials break down and expand. Hot aerosols and flammable gases are ejected from the battery at high speeds [4]. Figure 2 depicts the composition of battery vent gases collected from lithium ion batteries with different chemistries. Carbon monoxide, methane, ethylene, ethane, and hydrogen gas were detected across the various chemistries and all these gases are flammable [6]. The mixture of gases ejected could ignite under the right conditions [7].

Oxygen would be provided by the surrounding environment. The fuel and air mixture needs to be within the lower and upper flammability limits (LFL and UFL) for combustion to occur. The gas composition will determine key flammability properties including the LFL and burning velocity [7].

Batteries can undergo thermal runaway without subsequent fire. This observation is evident to anyone who has seen a cell phone battery pouch expand like a balloon, shown in Figure 4. Lab-scale testing in inert environments has been performed to quantify vent gas composition in the absence of flames [8]. The McMicken BESS incident in Surprise, AZ also demonstrated thermal runaway without ignition. A single battery rack had undergone thermal runaway, filling the container with flammable gas. The flammable gas/air mixture was initially too rich to burn. First responders arrived at the site and opened the container doors to investigate the failure. By doing so, they introduced enough oxygen into the environment and the heat inside the container ignited the gases [7]. The uncertainty

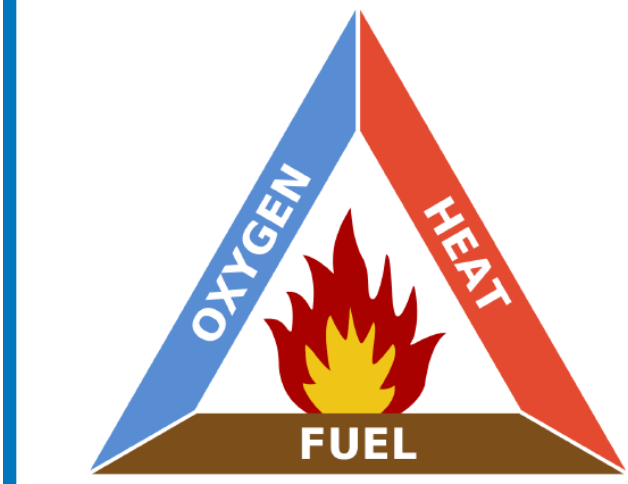


Figure 3 – "Fire triangle" by Gustavb is licensed under CC-BY-SA 3.0

of ignition was later encountered during testing at FM Global, Figure 5, where abuse testing of identical lithium ion battery modules showed that ignition of vented gases can be unpredictable even in a controlled laboratory setting [9].

The U.S. has seen rapid adoption of energy storage within the past decade with lithium ion technologies accounting for the majority of deployed capacity, seen in Figure 6. Lithium ion batteries present many favorable factors that contribute to this trend including cost, maturity, roundtrip efficiency, and flexibility.

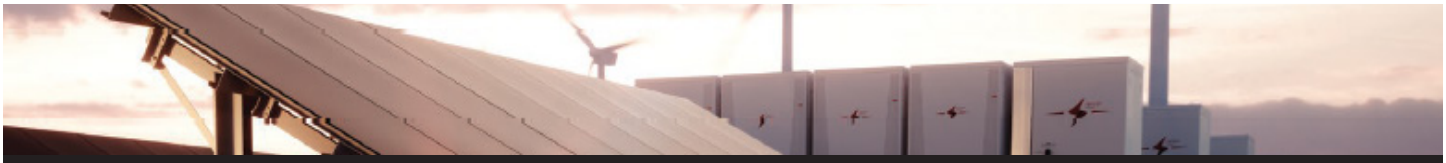




Figure 4 – Side-by-side comparison of a lithium ion polymer pouch cell that has undergone the onset of thermal runaway (left) and an undamaged cell (right) [10]. Image courtesy of Appuals.

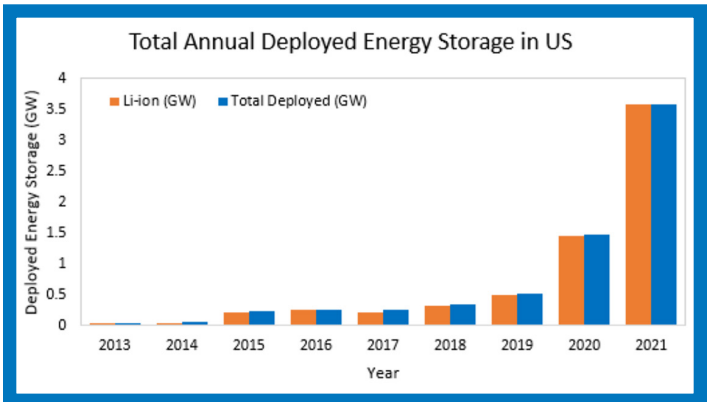



Figure 6 – Annual deployed energy storage in the US. Excludes Pumped Hydro Storage. [11].



Figure 5 – Lithium ion battery module thermal runaway leading to flammable gas release (left) and fire (right). Images courtesy of FM Global. Testing involved overheating of lithium iron phosphate cells without the presence of an external ignition [9].

The number of lithium ion battery energy storage failures is expected to increase with growing technology adoption. As of December 2022, EPRI's Battery Energy Storage System (BESS) Failure Event Database has recorded 56 stationary energy storage failure events across the globe since 2011; 49 of those events have occurred since 2018. In the US, there have been five incidents this year, an increase compared to the three incidents recorded in 2021 [12].

The statistics around thermal runaway occurrences vary and data collection to produce meaningful information is difficult. Assuming lithium ion battery cells are stored and operated within the recommended limits provided by the manufacturer, the rate of failure over the cell's lifetime has been estimated to be 1 in 10 million per a 2006 source or 1 in 40 million per a 2011 source [4, 13]. These statistics need to be updated, especially given that the actual rate of failure will be heavily influenced by unpredictable circumstances that could be classified as electrical, thermal, or mechanical abuse of the system. Furthermore, the sheer number of cells deployed means that failures are not only possible but will become more frequent. One representative electric car battery using 18650 type lithium ion cells can have ~8,000 cells. Assuming a failure rate of 1 in 40 million cells, nearly 1 in every 5,000 representative vehicles

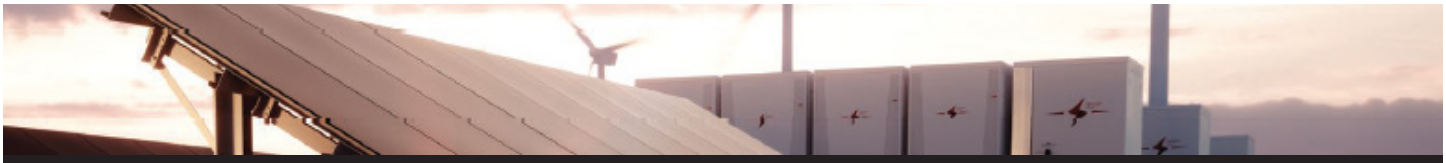

could fail due to a battery manufacturing defect over the product's lifetime. The number of cells in a stationary energy storage system will vary more depending on the size and form factor of the cells. The McMicken battery in Arizona (2MW/2MWh) had 10,584 cells [14], SCE's Mira Loma battery (20MW/80MWh) has 6,465,720 cells [15], and Vistra's Moss Landing Phase 1 (300MW/1200MWh) system has roughly 5,544,000 [16].

Thermal runaway is a major factor contributing to the fire and explosion risk that needs to be considered during all stages of system design. While this is often initially managed with battery and thermal management systems, newer installed systems may also include gas detection and ventilation to prevent fire and explosion if thermal runaway occurs. With enough research, the potential for subsequent fire and explosion may be controllable with proper system design and management but eliminating the threat of thermal runaway may remain a challenging goal.

References

1. Q. Wang, P. Ping, X. Zhao, G. Chu, J. Sun and S. Chen, "Thermal runaway caused fire and explosion of lithium ion battery," *Journal of Power Sources*, vol. 208, no. 15, pp. 210-224, 2012.
2. P. G. Balakrishnan, R. Ramesh and T. Prem Kumar, "Safety mechanisms in lithium-ion batteries," *Journal of Power Sources*, vol. 155, no. 2, pp. 401-414, 2006.
3. B. Barnett, D. Ofer, S. Sriramulu and R. Stringfellow, "Lithium-Ion batteries, safety," in *Batteries for Sustainability*, Springer, 2013, pp. 285-318.
4. Q. Wang, B. Mao, S. I. Stoliarov and J. Sun, "A review of Lithium ion battery failure mechanisms and fire prevention strategies," *Pro. Energy Combust. Sci.*, vol. 73, pp. 95-131, 2019.
5. A. P. Vanesa Ruiz, "JRC exploratory research: Safer Li-ion batteries by preventing thermal propagation - Workshop report: summary & outcomes," Publications Office of the European Union, Luxembourg, 2018.
6. A. Golubkov, D. Fuchs, J. Wagner, H. Wiltsche, C. Stangl, G. Fauler, G. Voitic, A. Thaler and V. Hacker, "Thermal-runaway experiments on consumer Li-ion batteries with metal-oxide and olivine-type cathodes," *RSC Adv.*, vol. 4, pp. 3633-3642, 2014.
7. *Battery Energy Storage Systems Explosion Hazards.* EPRI, Palo Alto, 2021. 3002022706.
8. D. Sturk, L. Rosell and P. T. A. A. Blomqvist, "Analysis of Li-Ion Battery Gases Vented in an Inert Atmosphere Thermal Test Chamber," *batteries*, vol. 5, no. 61, B019.
9. B. Ditch and D. Zeng, "Development of Sprinkler Protection Guidance for Lithium Ion Based Energy Storage Systems," FM Global, Norwood, 2020.
10. K. Arrows, "Fix: HTC One M8 Not Charging," Appuals, [Online]. Available: https://appuals.com/fix-htc-one-m8-not-charging/.
11. Wood Mackenzie, "U.S. energy storage monitor: Q4 2021 report," 2022.
12. EPRI, "BESS Failure Event Database," 2022. [Online]. Available: https://storagewiki.epri.com/index.php/BESS_Failure_Event_Database.
13. D. H. Doughty and E. P. Roth, "A general discussion of Li ion battery safety," *Electrochem Soc. Interface*, vol. 21, pp. 37-44, 2012.
14. D. Hill, "McMicken Battery Energy Storage System Event Technical Analysis and Recommendations," DNV GL, 2020.
15. J. Golson, "Millions of Tesla battery cells are powering thousands of LA homes," The Verge, 6 February 2017. [Online]. Available: https://www.theverge.com/2017/2/6/14523196/tesla-battery-powerpack-los-angeles-electricity. [Accessed May 2022].
16. S. Patel, "Vistra Energizes Massive 1.2-GWh Battery System at California Gas Plant," POWER, 14 January 2021. [Online]. Available: https://www.powermag.com/vistra-energizes-massive-1-2-gwh-battery-system-at-california-gas-plant/. [Accessed May 2022].

Acknowledgments

Co-author:

Benjamin Ditch
Senior Lead Research Engineer
FM Global

DISCLAIMER OF WARRANTIES AND LIMITATION OF LIABILITIES

THIS DOCUMENT WAS PREPARED BY THE ORGANIZATION(S) NAMED BELOW AS AN ACCOUNT OF WORK SPONSORED OR COSPONSORED BY THE ELECTRIC POWER RESEARCH INSTITUTE, INC. (EPRI). NEITHER EPRI, ANY MEMBER OF EPRI, ANY COSPONSOR, THE ORGANIZATION(S) BELOW, NOR ANY PERSON ACTING ON BEHALF OF ANY OF THEM:

(A) MAKES ANY WARRANTY OR REPRESENTATION WHATSOEVER, EXPRESS OR IMPLIED, (I) WITH RESPECT TO THE USE OF ANY INFORMATION, APPARATUS, METHOD, PROCESS, OR SIMILAR ITEM DISCLOSED IN THIS DOCUMENT, INCLUDING MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, OR (II) THAT SUCH USE DOES NOT INFRINGE ON OR INTERFERE WITH PRIVATELY OWNED RIGHTS, INCLUDING ANY PARTY'S INTELLECTUAL PROPERTY, OR (III) THAT THIS DOCUMENT IS SUITABLE TO ANY PARTICULAR USER'S CIRCUMSTANCE; OR

(B) ASSUMES RESPONSIBILITY FOR ANY DAMAGES OR OTHER LIABILITY WHATSOEVER (INCLUDING ANY CONSEQUENTIAL DAMAGES, EVEN IF EPRI OR ANY EPRI REPRESENTATIVE HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES) RESULTING FROM YOUR SELECTION OR USE OF THIS DOCUMENT OR ANY INFORMATION, APPARATUS, METHOD, PROCESS, OR SIMILAR ITEM DISCLOSED IN THIS DOCUMENT.

REFERENCE HEREIN TO ANY SPECIFIC COMMERCIAL PRODUCT, PROCESS, OR SERVICE BY ITS TRADE NAME, TRADEMARK, MANUFACTURER, OR OTHERWISE, DOES NOT NECESSARILY CONSTITUTE OR IMPLY ITS ENDORSEMENT, RECOMMENDATION, OR FAVORING BY EPRI.

THE ELECTRIC POWER RESEARCH INSTITUTE (EPRI) PREPARED THIS REPORT.

Note

For further information about EPRI, call the EPRI Customer Assistance Cen- ter at 800.313.3774 or e-mail askepri@epri.com.

EPRI RESOURCES

Taylor Kelly, *Technical Leader*
650.855.7938, tkelly@epri.com

Lakshmi Srinivasan, *Senior Technical Leader*
202.293.7512, lsrinivasan@epri.com

Energy Storage

About EPRI

Founded in 1972, EPRI is the world's preeminent independent, non-profit energy research and development organization, with offices around the world. EPRI's trusted experts collaborate with more than 450 companies in 45 countries, driving innovation to ensure the public has clean, safe, reliable, affordable, and equitable access to electricity across the globe. Together, we are shaping the future of energy.



Export Control Restrictions

Access to and use of this EPRI product is granted with the specific understanding and requirement that responsibility for ensuring full compliance with all applicable U.S. and foreign export laws and regulations is being undertaken by you and your company. This includes an obligation to ensure that any individual receiving access hereunder who is not a U.S. citizen or U.S. permanent resident is permitted access under applicable U.S. and foreign export laws and regulations.

In the event you are uncertain whether you or your company may lawfully obtain access to this EPRI product, you acknowledge that it is your obligation to consult with your company's legal counsel to determine whether this access is lawful. Although EPRI may make available on a case by case basis an informal assessment of the applicable U.S. export classification for specific EPRI products, you and your company acknowledge that this assessment is solely for informational purposes and not for reliance purposes.

Your obligations regarding U.S. export control requirements apply during and after you and your company's engagement with EPRI. To be clear, the obligations continue after your retirement or other departure from your company, and include any knowledge retained after gaining access to EPRI products.

You and your company understand and acknowledge your obligations to make a prompt report to EPRI and the appropriate authorities regarding any access to or use of this EPRI product hereunder that may be in violation of applicable U.S. or foreign export laws or regulations.

3002025283 December 2022

EPRI
3420 Hillview Avenue, Palo Alto, California 94304-1338 • USA
800.313.3774 • 650.855.2121 • askepri@epri.com • www.epri.com

© 2022 Electric Power Research Institute (EPRI), Inc. All rights reserved. Electric Power Research Institute, EPRI, and TOGETHER...SHAPING THE FUTURE OF ENERGY are registered marks of the Electric Power Research Institute, Inc. in the U.S. and worldwide.